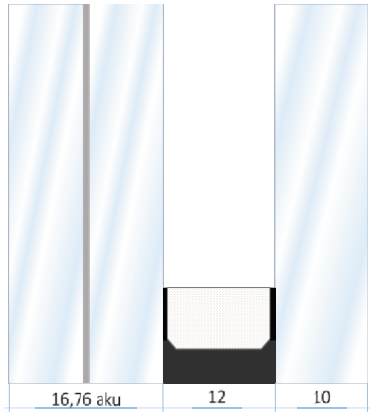


Evidence of performance
Airborne sound insulation of building components

Test Report

No. GLA-1301.1/17 E

Client**PRESS GLASS S.A.**Nowa Wieś
ul. Kopalniana 9
42-262 Poczesna

Product:	Insulating glass unit
Construction:	16,76Aku/12/10
Designation:	VSG (FL 8/0,76SC/FL 8) kl.1/B/1/12/TH1,1 10 Ar
Dimension:	1230 mm x 1480 mm
Gas filing:	Argon
Area related mass	67 kg/m ²
Cross-section:	

Rating	R _w (C; C _{tr})	STC	OITC
Basis	EN ISO 10140-1:2010 EN ISO 10140-2:2010 EN ISO 717-1: 2013	ASTM E413-10	ASTM E1332-10
Value	44 (-1; -4) dB	44 dB	36 dB

Łozienica, 20.01.2017


PhD Krzysztof Mech
Head of Acoustics Laboratory