

**Evidence of performance**  
**Airborne sound insulation building components**

Test Report

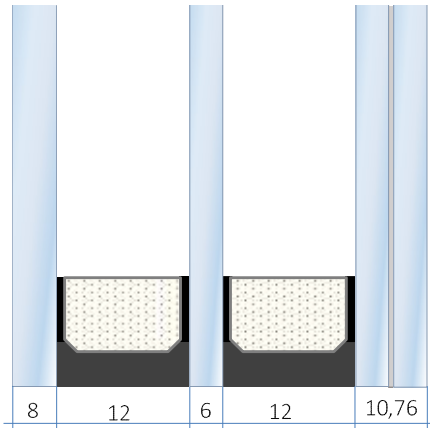
No. GLA-1255.3/16

Client**PRESS GLASS S.A.**

Nowa Wieś

ul. Kopalniana 9

42-262 Poczesna

Product:	Insulating glass unit
Construction:	8 / 12 / 6 / 12 / 55.2
Designation:	FL 8 / 12+Ar / FL 6 / 12+Ar / Laminated glass 55.2 class P2A
Dimension:	1230mm x 1480mm
Gas filing:	Argon
Cross-section:	

Rating	$R_w (C; C_{tr})$	STC	OITC
Basis	PN-EN ISO 717-1: 2013	ASTM E413-10	ASTM E1332-10
Value	<b>43 (-2; -6) dB</b>	<b>43 dB</b>	<b>34 dB</b>

Łozienica, 05.05.2016

  
**PhD Krzysztof Mech**  
Head of Acoustics Laboratory