

Evidence of performance
Airborne sound insulation building components

Test Report

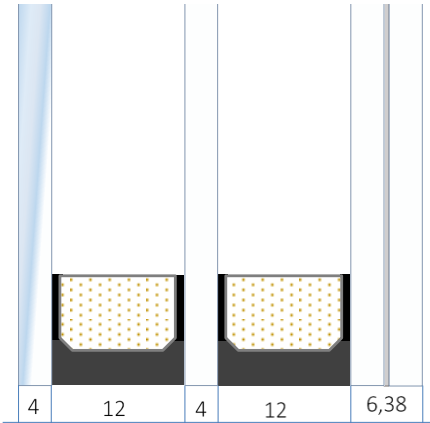
No. GLA-1255.4/16

Client**PRESS GLASS S.A.**

Nowa Wieś

ul. Kopalniana 9

42-262 Poczesna

Product:	Insulating glass unit
Construction:	4 / 12 / 4 / 12 / 33.1
Designation:	FL 4 / 12+Ar / FL 4 / 12+Ar / Laminated glass 33.1 class 2B2
Dimension:	1230mm x 1480mm
Gas filing:	Argon
Cross-section:	

<i>Rating</i>	R_w (C; C_{tr})	STC	OITC
<i>Basis</i>	PN-EN ISO 717-1: 2013	ASTM E413-10	ASTM E1332-10
<i>Value</i>	35 (-1; -6) dB	35 dB	26 dB

Łozienica, 05.05.2016


PhD Krzysztof Mech
Head of Acoustics Laboratory