

**Evidence of performance**  
**Airborne sound insulation building components**

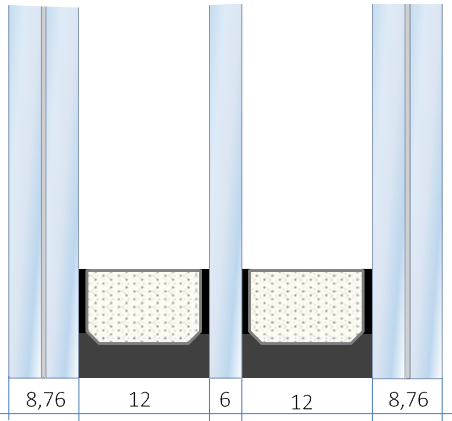
Test Report

**No. GLA-1255.5/16**Client**PRESS GLASS S.A.**

Nowa Wieś

ul. Kopalniana 9

42-262 Poczesna

Product:	Insulating glass unit
Construction:	44.2 / 12 / 6 / 12 / 44.2
Designation:	Laminated glass 44.2 class P2A / 12+Ar / FL 6 / 12+Ar / Laminated glass 44.2 class P2A
Dimension:	1230mm x 1480mm
Gas filing:	Argon
Cross-section:	

Rating	$R_w (C; C_{tr})$	STC	OITC
Basis	PN-EN ISO 717-1: 2013	ASTM E413-10	ASTM E1332-10
Value	<b>40 (-3; -8) dB</b>	<b>39 dB</b>	<b>29 dB</b>

Łozienica, 05.05.2016

  
**PhD Krzysztof Mech**  
Head of Acoustics Laboratory