

Evidence of performance Airborne sound insulation building components

Test Report

No. GLA-1239/15 E

Opinion from the scope of sound insulation

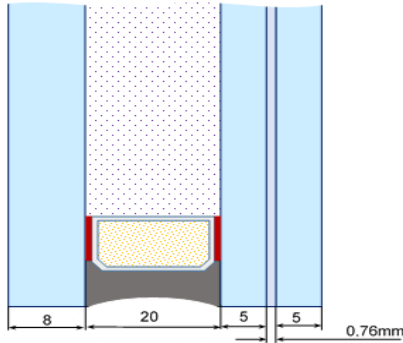
No. GLA – 1239 – O/15 E

Client:**PRESS GLASS S.A.**

Nowa Wieś

ul. Kopalniana 9

42-262 Poczesna

<i>Product:</i>	Insulating glass unit
<i>Construction:</i>	8/20/55.2
<i>Designation:</i>	FL8mm/20+Ar/VSG10,76mm (FL5mm/0,76PVB/FL5mm)
<i>Dimension:</i>	1230mm x 1480mm
<i>Gas filing:</i>	Argon
<i>Cross-section:</i>	

<i>Rating</i>	R_w (C; C_{tr})	STC	OITC
<i>Basis</i>	PN-EN ISO 717-1: 2013	ASTM E413-10	ASTM E1332-10
<i>Value</i>	42 (-2; -5) dB	42 dB	34 dB

Łozienica, 04.03.2016


PhD Krzysztof Mech
Head of Acoustics Laboratory